

CLASSIFICATION REPORT EFR-24-005118 - CR

Issuing body	EFFECTIS France Espace Technologique Bâtiment Explorer Route de l'Orme des Merisiers 91190 SAINT-AUBIN FRANCE
Notified body	1812
Concerning	Glazed partition wall from the serie VISS FIRE (JANSEN) in line. Glazing: Pyrobel-T EW30-16 (AGC) Pyrobel-T EW30-16 TGU (AGC)
Sponsor	AGC GLASS EUROPE 4, Avenue Jean Monnet B - 1348 LOUVAIN-LA-NEUVE BE0413.638.187

1. SCOPE

This fire resistance classification report defines the classification assigned to the component VISS FIRE (JANSEN) according to the paragraph 7.5.2 of the standard EN 13501-2 : 2023.

The element is classified for the first time.

2. CLASSIFIED PRODUCT DETAILS

Its function is to resist fire according to the characteristic fire performance of clause 5 of standard EN 13501-2 from the inside to the outside or vice versa. The classification is made for both direction of fire (i ->o and o ->i).

The classification includes horizontal and vertical connections.

The element is described below in test reports mentioned in the paragraph 3. to prove the classification.

3. TEST REPORTS / EXTENDED FIELD OF APPLICATION REPORT

3.1. REFERENCE DOCUMENTS

Laboratory	Sponsor	Reference of the document	Standard
EFFECTIS France	AGC	EFR-19-G-004491	EN 1364-3 : 2014
EFFECTIS France	AGC	EFR-19-G-004492	EN 1364-3 : 2014
WARRINGTONFIREGENT	AGC	21963A	EN 1364-1 : 2015
WARRINGTONFIREGENT	AGC	21965A	EN 1364-1 : 2015

3.2. RESULTS

The tests mentioned below have been realized in accordance with the current standard EN 1364-3: 2014 and EN 1364-1: 2015.

Note: all test reports are mentioned in detail in extended field of application report EFR-24-005118-EXAP.

Reference of test report	Laboratory	Sponsor	Standard
EFR-19-G-004491	EFFECTIS France Notified body: 1812	AGC	EN 1364-3 : 2014
	Supporting construction	concrete according to EN 1364-3 and cellular concrete on its bottom	
	Fire direction	o → i	
	Fire resistance criteria	Duration	
	E – Sustained flaming (S1)	35 minutes	
	E – Gap gauge (S1)	45 minutes	
	E – Cotton wool pad (S1)	45 minutes	
	I – Mean temperature (S1)	30 minutes	
	I – Maximal temperature (S1)	26 minutes	
	W – Maximal radiation (15 kW/m ²)	45 minutes	

Reference of test report	Laboratory	Sponsor	Standard
EFR-19-G-004492	Efectis France Notified body: 1812	AGC	EN 1364-3 : 2014
	Supporting construction	Reinforced concrete according to EN 1364-3	
	Fire direction	i -> 0	
	Fire resistance criteria	Duration	
	E – Sustained flaming (S2)	34 minutes	
	E – Gap gauge (S2)	40 minutes	
	E – Cotton wool pad (S2)	40 minutes	
	I – Mean temperature (S2)	/	
	I – Maximal temperature (S2)	/	
	W – Maximal radiation (15 kW/m ²)	40 minutes	

Reference of test report	Laboratory	Sponsor	Standard
21963A	Warringtonfiregent	AGC	EN 1364-1 : 2015
	Supporting construction	Concrete according to EN 1364-3	
	Fire direction	i -> 0	
	Fire resistance criteria	Duration	
	E – Sustained flaming	58 minutes	
	E – Gap gauge	66 minutes	
	E – Cotton wool pad	66 minutes	
	I – Mean temperature	29 minutes	
	I – Maximal temperature	10 minutes	
	W – Maximal radiation (15 kW/m ²)	66 minutes	

Reference of test report	Laboratory	Sponsor	Standard	
21965A	Warringtonfiregent	AGC	EN 1364-1 : 2015	
	Supporting construction	Concrete according to EN 1364-3		
	Fire direction	i <-> 0		
	Fire resistance criteria		Duration	
	E – Sustained flaming		51 minutes	
	E – Gap gauge		52 minutes	
	E – Cotton wool pad		52 minutes	
	I – Mean temperature		28 minutes	
	I – Maximal temperature		26 minutes	
	W – Maximal radiation (15 kW/m ²)		52 minutes	

4. DESCRIPTION OF THE PRODUCT

4.1. FRAMEWORK

The framework of the partition wall is made of steel profiles from the VISS FIRE TVS (JANSEN) series.

The mullions and the transoms forming the “+” junction and the “⊥” junction are made of steel profiles of reference 76.694 (JANSEN) with a section of 50 x 50 mm and a thickness of 1.5 mm.

All the other mullions and transoms are made of steel profiles of reference 76.697 (JANSEN) with a section of 95 x 50 mm and a thickness of 1.5 mm.

All the profiles present a groove equipped with stainless steel fastening anchors of reference 452.427 (JANSEN) located every 400 mm at maximum.

The transoms are fixed to the mullions by welding. There is no possible dilatation between the transoms and the mullions.

The inner transoms may also be fixed with a connecting spigot bolt, reference 452.062 (JANSEN).

4.2. INFILL ELEMENTS

4.2.1. Glazing

The partition wall defines openings filled with:

- Either Pyrobel-T EW30-16 (AGC) glazing whose exact composition is in the possession of the laboratory
- Or Pyrobel-T EW30-16 TGU (AGC) glazing composed of:
 - a Pyrobel-T EW30-16 (AGC) glazing
 - a 15 mm thick steel spacer;
 - a 6 mm toughened glazing;
 - a 15 mm thick steel spacer;
 - a 44.2 laminated glazing made of:
 - a 4 mm thick float glazing;
 - two 0.38 mm thick standard PVB-layers;
 - a 4 mm thick float glazing.

All around of each Pyrobel-T EW30-16 (AGC), an intumescent tape of reference FLAMISEAL G (ETANCHEITE JUNG) with a section of 16 x 2 mm is applied.

Each Pyrobel-T EW30-16 TGU (AGC) corner is protected horizontally and vertically by an intumescent tape of reference FLAMISEAL® G (ETANCHEITE-JUNG) with dimensions of 62 x 2 x 100 mm.

4.2.2. Panels

The openings of the partition wall in the part exposed to fire may be filled by:

- a 75 mm thick opaque panel is made of:
 - a 1.5 mm thick steel sheet;
 - a 12 mm thick calcium silicate plate of reference PROMATECH-H (PROMAT);
 - a (40+20) mm thick mineral wool layer of reference ROCKFACADE (ROCKWOOL) with a density of 35-39 kg/m³, opposite to the pressure plates side;
 - a 1.5 mm thick steel sheet.

The components are assembled together by glue (PYROCOL) at a rate of 60 g/m² and to the profiles by steel screws Ø4.2 x 50 mm every 300 mm.

4.2.3. Infill elements holding system

The infill elements are held in place by 1.5 mm thick steel pressure plates, reference 400.867 (JANSEN) with section 47 x 10 mm, fixed by stainless steel fastening anchors of reference:

- 452.453 (JANSEN) for Pyrobel-T EW30-16 (AGC) and panels
- 452.587 (JANSEN) for Pyrobel-T EW30-16 TGU (AGC)

placed every 400 mm, after interposition of two intumescent tapes of reference 451.080 (JANSEN) of section 14.4 x 1.8 mm installed side by side.

The pressure plates are covered with:

- For Pyrobel-T EW30-16 (AGC) and panels:
 - a 1.5 mm thick aluminium cover profile, reference 407.861 (JANSEN) with a section of 50 x 18 mm, for the mullions;
 - a 1.5 mm thick aluminium cover profile, reference 407.860 (JANSEN) with a section of 50 x 12 mm, for the transoms.
- For Pyrobel-T EW30-16 TGU (AGC):
 - a 1.5 mm thick aluminium cover profile, reference 407.862 (JANSEN) with a section of 50 x 25 mm for the mullions;
 - a 1.5 mm thick aluminium cover profile, reference 407.861 (JANSEN) with a section of 50 x 18 mm for the transoms.

The mullions are provided with an EPDM gasket, reference 455.558 (JANSEN) and section 50 x 10 mm. The transoms are provided with an EPDM gasket, reference 455.537 (JANSEN) and section 50 x 10 mm.

The pressure plates associated to the mullions are provided with two EPDM gaskets, reference 455.520 (JANSEN).

The pressure plates associated to the transoms are provided on the top with an EPDM gasket reference 455.520 (JANSEN) and on the bottom with an EPDM gasket reference 455.521 (JANSEN).

The Pyrobel-T EW30-16 (AGC) and panels are supported by setting blocks, section 80 x 19 x 6 mm, reference 453.027 (JANSEN), in their lower part, set on:

- For the biggest glazing, 10 mm thick steel plates of dimensions 100 x 44 mm axed at 200 mm from the extremity of the opening and welded in the groove of the transom;
- For the other infill elements, stainless steel glazing supports reference 452.454 (JANSEN) axed at 200 mm from each extremity of each opening and fixed in the groove of the transoms with one steel screw M4 x 10 mm placed in one stainless steel fastening bolt of reference 452.453 (JANSEN).

The Pyrobel-T EW30-16 TGU (AGC) are supported by 80 x 60 x 5 mm reference 453.070 (JANSEN) in their lower part, set on steel plates with dimensions of 100 x 88 x 10 mm axed at 200 mm from each extremity of each opening and welded in the groove of the profiles.

Infill element rebate bottom clearance:

- Lateral : 7 mm;
- Top : 8 mm;
- Bottom : 9 mm.

Edge cover of the infill elements:

- Lateral : 14 mm;
- Top : 13 mm;
- Bottom : 12 mm.

4.2.4. Fastening

Each mullion is fixed at each extremity to the corresponding concrete slab by a system made of one 3 mm thick steel tube of section 45 x 75 mm and 150 mm length, welded on a 10 mm thick steel plate of section 50 x 125 mm, itself screwed on the corresponding slab by two steel anchor bolts 100 HT Ø 10 x 72 mm (HILTI). At the bottom of the partition wall, a PROMATECT-H (PROMAT) plate of section 90 x 20 mm are placed under the bottom transom close to each mullion. Each mullion can thus dilate from 20 mm.

The 30 mm thick gap between the transoms and the supporting construction is sealed with mineral wool of reference PROMAGLAF HTK 1100 (PROMAT) with a theoretical density of 96 kg/m³.

The whole periphery of the partition wall is filled with spacers made of one layer of PROMATECT-H boards (PROMATECT-H) and section 58 x 25 mm. They are fixed between the holding system of the partition wall after insertion of steel angle profiles of overall section 25 x 25 x 2 mm on the fire side on the transom levels. See figures n°4 to 5.

5. CLASSIFICATION AND FIELD OF APPLICATION

5.1. CLASSIFICATION REFERENCE

This classification has been carried out in accordance with paragraph 7.5.2. of standard EN 13501-2: 2023.

5.2. CLASSIFICATION

The element is classified according to the following combinations of performance parameters and classes :

R	E	I	W		T	-	M	C	S	G	K
	E		W	(i ↔ o)	30						
	E			(i ↔ o)	30						

5.3. FIELD OF APPLICATION

The variations of the product are defined as follows according to the field of direct application of the test results for the classification stated in paragraph 4.2.

The field of direct application below is mentioned for reference tests described in paragraph 3.1 and the additional variants and end-use details are given in extended field of application report.

The design parameters specified therein are not limited by the following field of application.

Standard of reference EN 1364-1 : 2015	Permitted changes to element tested
A.4.1	<p>General</p> <p>The test results are directly applicable to similar constructions where one or more of the changes in this A.4 are made and the construction continues to comply with the appropriate design code for its stiffness and stability. Other changes are not permitted.</p> <p>The result of a test on a specimen with mixtures of different types of construction (e.g. different types of glass or different types of framing, etc.) is only applicable to that tested.</p>
A.4.2	Field of direct application rules not requiring overrun time
A.4.2.1	Glazed element
A.4.2.1.1	<p>Installation angle</p> <p>Test results on vertical glazed elements cover glazed elements sloped to a maximum angle of $\pm 10^\circ$ from the vertical plane, provided the height of the glazed element is not larger than the maximum height tested.</p>
A.4.2.1.3	<p>Width of the glazed element</p> <p>Test results cover rectangular glazed elements of greater width by replication of the tested glazed element or parts thereof, provided:</p> <ul style="list-style-type: none"> a. the framing system is identical to the one tested; b. the width of the specimen in the test was 2,8 m or greater with one vertical edge unrestrained; c. the mullions within and/or connection joints between glazed elements have been tested. <p>In case of elements intended to be classified for EW, the following additional provisions apply: the average temperature of the unexposed face of the glazed element as well as the average temperature of the unexposed face of the non-glazed area of the test specimen (see Figures 12 or 14) remained below 300 °C, or the heat radiation measured from the complete and fully glazed test element with minimum size of 2,8 x 2,8 m did not exceed 12,3 kW/m².</p>
A.4.2.2	Glazing system (see Figure 16)
A.4.2.2.1	<p>Linear dimensions</p> <p>The linear dimensions of panes may be decreased from the dimensions tested. Height and width may be considered independently.</p>
A.4.2.3	<p>Framing system (see Figure 16)</p> <p>The distance between mullions and/or transoms may be decreased from that tested.</p> <p>The distance between fixing centres may be decreased from that tested.</p> <p>The cross sectional dimensions of the frame profiles may be increased from the dimensions tested, under the following restrictions:</p> <p>For combustible framing intended to be used for E and/or EW classification, the depth of the frame profiles on the unexposed side is as tested.</p>

A.4.2.4	Supporting constructions												
A.4.2.4.1	<p>General For specimens tested in the test frame without any supporting construction, the result is applicable to high density rigid supporting constructions with at least the same fire resistance as the test specimen.</p>												
A.4.3	Field of direct application rules requiring overrun time												
A.4.3.1	<p>General For some rules to be applicable an overrun time in the fire test result compared to the intended classification period is required.</p> <p>The required overrun time is shown in Table A.1.</p> <p>Table A.1 - Overrun time</p> <table border="1" data-bbox="456 689 1297 943"> <thead> <tr> <th>Intended classification period (min)</th> <th>Overrun time A (min)</th> <th>Overrun time B (min)</th> </tr> </thead> <tbody> <tr> <td>≤ 20</td> <td>not applicable</td> <td>≥ 3</td> </tr> <tr> <td>30, 45 and 60</td> <td>≥ 3 and < 6</td> <td>≥ 6</td> </tr> <tr> <td>≥ 90</td> <td>≥ 5% and < 10% of the intended classification period</td> <td>≥ 10 % of the intended classification period</td> </tr> </tbody> </table> <p>NOTE: The rules given in A.4.3 may be used in addition to the rules in A.4.2.</p>	Intended classification period (min)	Overrun time A (min)	Overrun time B (min)	≤ 20	not applicable	≥ 3	30, 45 and 60	≥ 3 and < 6	≥ 6	≥ 90	≥ 5% and < 10% of the intended classification period	≥ 10 % of the intended classification period
Intended classification period (min)	Overrun time A (min)	Overrun time B (min)											
≤ 20	not applicable	≥ 3											
30, 45 and 60	≥ 3 and < 6	≥ 6											
≥ 90	≥ 5% and < 10% of the intended classification period	≥ 10 % of the intended classification period											
A.4.3.2	Dimensions of the glazed element												
A.4.3.2.1	<p>Height The test result of the glazed element covers the height up to a maximum of the tested height multiplied by a factor of 1,1 provided overrun time A is achieved. This is irrespective of the measured deflections. The test result of the glazed element covers the height up to a maximum of the tested height multiplied by a factor of 1,2 provided overrun time B is achieved. This is irrespective of the measured deflections. In case of elements intended to be classified for EW, the following additional provisions apply: the average temperature of the unexposed face of the glazed element as well as the average temperature of the unexposed face of the non-glazed area of the test specimen (Figure 12 or 14) remained below 300 °C, or the heat radiation measured from the complete and fully glazed element did not exceed 12,3 kW/m².</p>												
A.4.3.2.2	<p>Width The replication of the glazed element is covered based on rules described in A.4.2.1.3. For glazed elements tested with a width smaller than 2,8 meter, the following rules apply. The test result of the glazed element covers the width up to a maximum of the tested width multiplied by a factor of 1,1 provided overrun time A is achieved. This is irrespective of the measured deflections. The test result of the glazed element covers the width up to a maximum of the tested width multiplied by a factor of 1,2 provided overrun time B is achieved. This is irrespective of the measured deflections. In case of elements intended to be classified for EW, the following additional provisions apply: the average temperature of the unexposed face of the glazed element as well as the average temperature of the unexposed face of the non-glazed area of the test specimen (Figure 12 or 14) remained below 300 °C, or the heat radiation measured from the complete and fully glazed element did not exceed 12,3 kW/m².</p>												

<p>A.4.3.3</p>	<p>Dimensions and area of individual rectangular glass panes The test result of a pane covers dimensions up to a maximum of the tested dimensions multiplied by a factor 1,1 in width and/or height, provided overrun time A is achieved and the maximum tested area multiplied by a factor 1,1 is not exceeded. The test result of a pane covers dimensions up to a maximum of the tested dimensions multiplied by a factor 1,2 in width and/or height, provided overrun time B is achieved and the maximum tested area multiplied by a factor 1,21 is not exceeded. In case of elements intended to be classified for EW, the following additional provisions apply: the average temperature of the unexposed face of the glazed element as well as the average temperature of the unexposed face of the non-glazed area of the test specimen (see Figure 12 or 14) remained below 300 °C, or the heat radiation measured from the complete and fully glazed element did not exceed 12,3 kW/m². In order to accommodate the increase in glass dimensions, it is permitted to increase the distance between mullions and/or transoms.</p>
<p>A.4.3.5</p>	<p>Area of individual circular, triangular and four side non-rectangular glass panes The test result from individual circular, triangular and four sided non rectangular glass panes covers the area up to a maximum of the tested area multiplied by a factor 1,1 provided overrun time A is achieved. The test result from individual circular, triangular and four sided non rectangular glass panes covers the area up to a maximum of the tested area multiplied by a factor 1,2 provided overrun time B is achieved. The pane shall be of the same orientation and shape (including maintaining internal angles) as the tested pane. In order to accommodate the increase in glass area, it is permitted to increase the distance between mullions and/or transoms.</p>

6. LIMITATIONS

This classification document does not represent type approval or certification of the product.

These conclusions relate only to the fire resistance performance of the element covered by this classification report. They do not prejudice, in any case, other performances related to its incorporation in a work.

Saint-Aubin, March 20th, 2025


X 

Project leader
Signé par : Virginie GOULON


X 

Supervisor
Signé par : Andréa VIARD


DRAWINGS APPENDIX: Plate No. 1

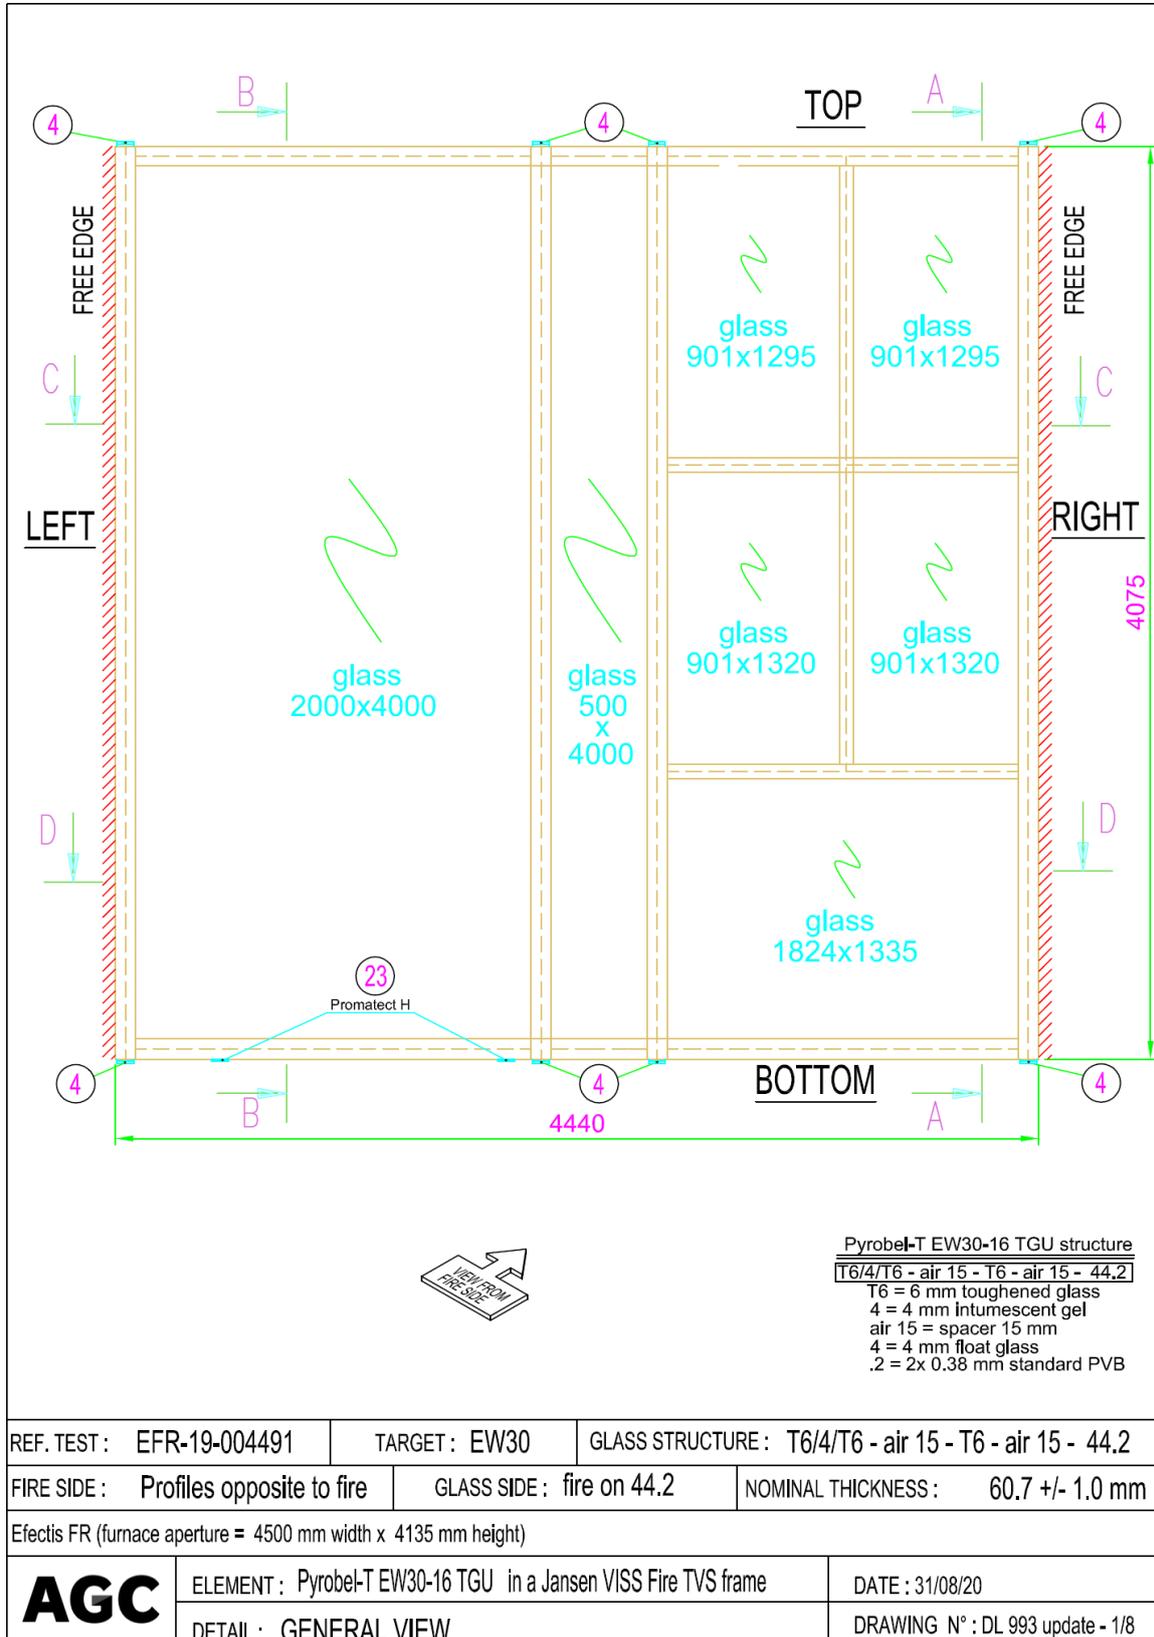


DRAWINGS APPENDIX: Plate No. 2

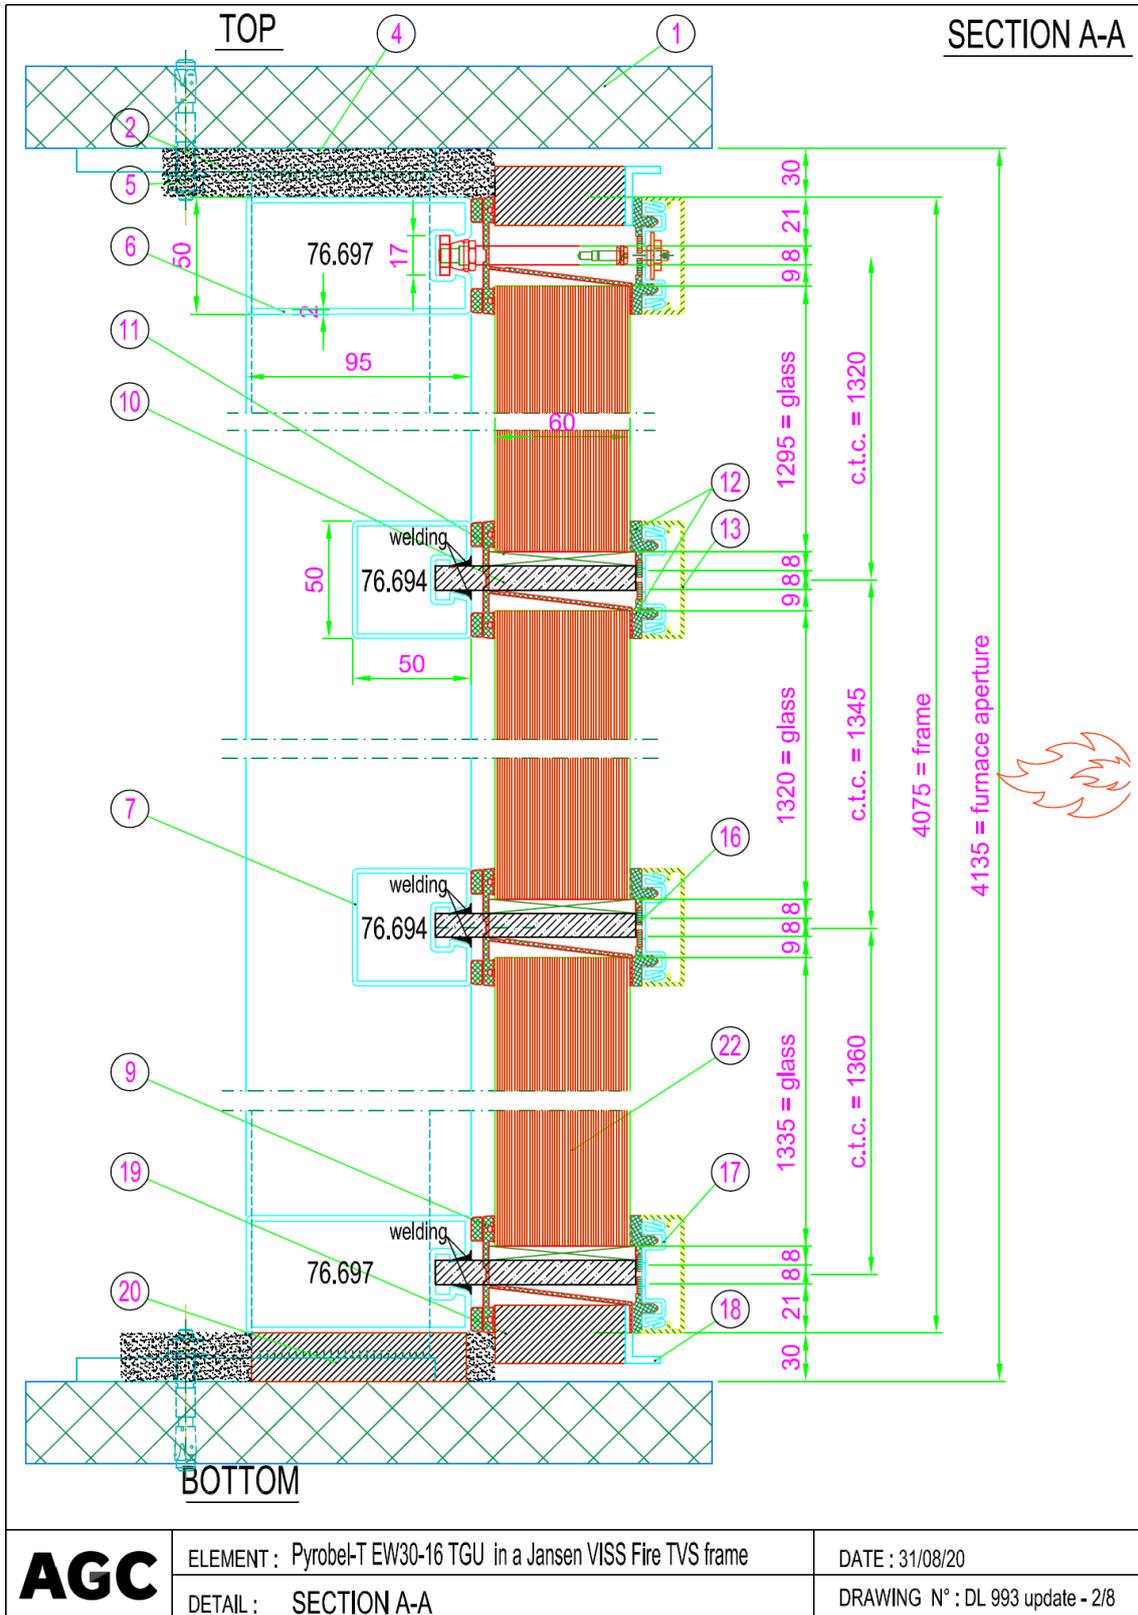


DRAWINGS APPENDIX: Plate No. 3

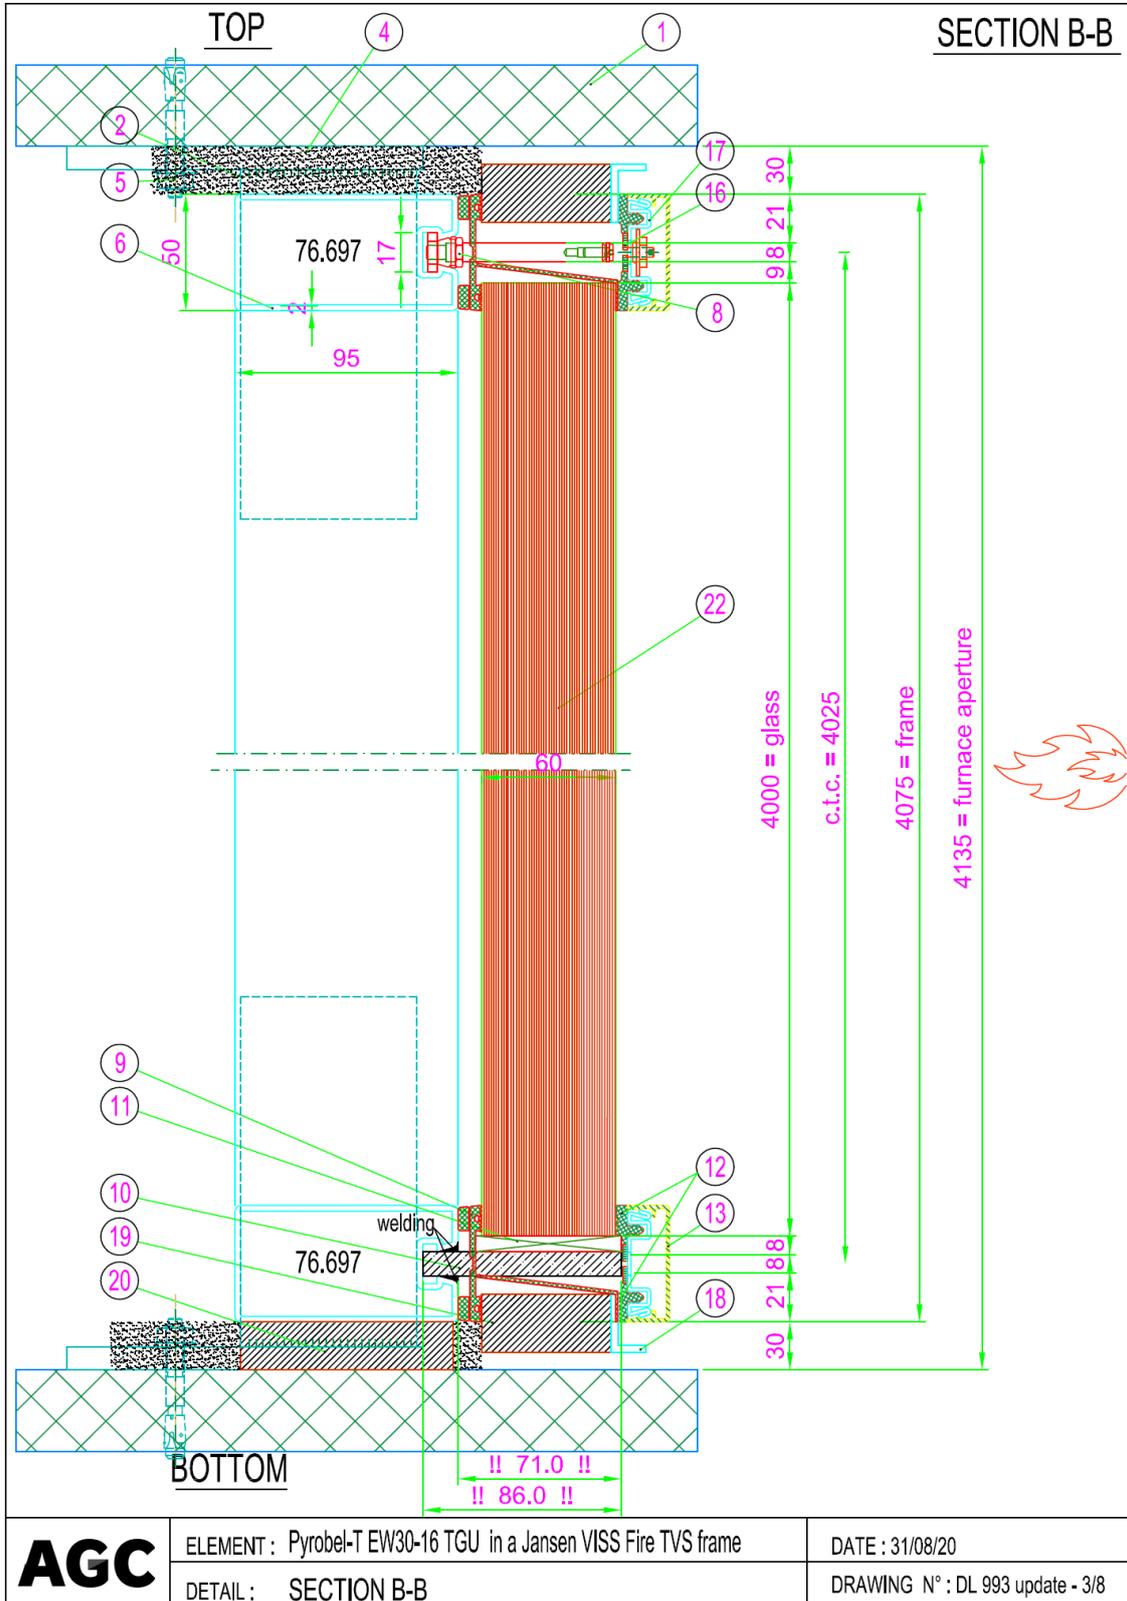


DRAWINGS APPENDIX: Plate No. 5

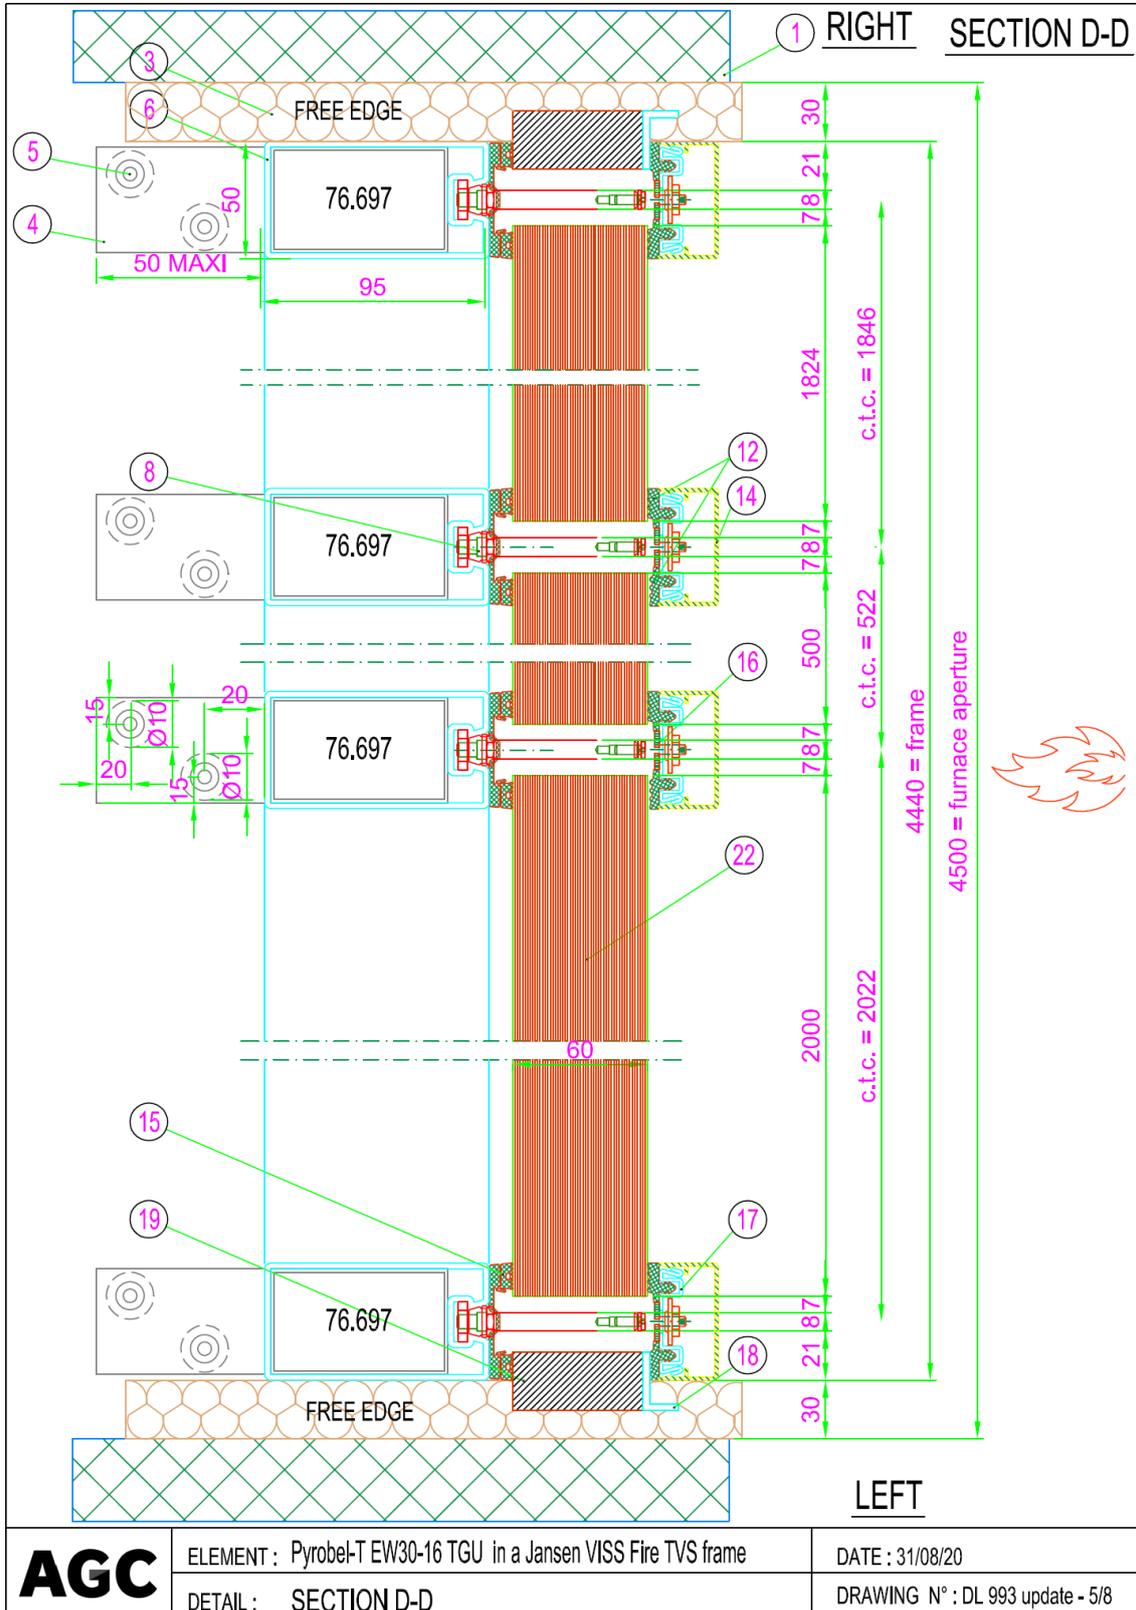

DRAWINGS APPENDIX: Plate No. 6

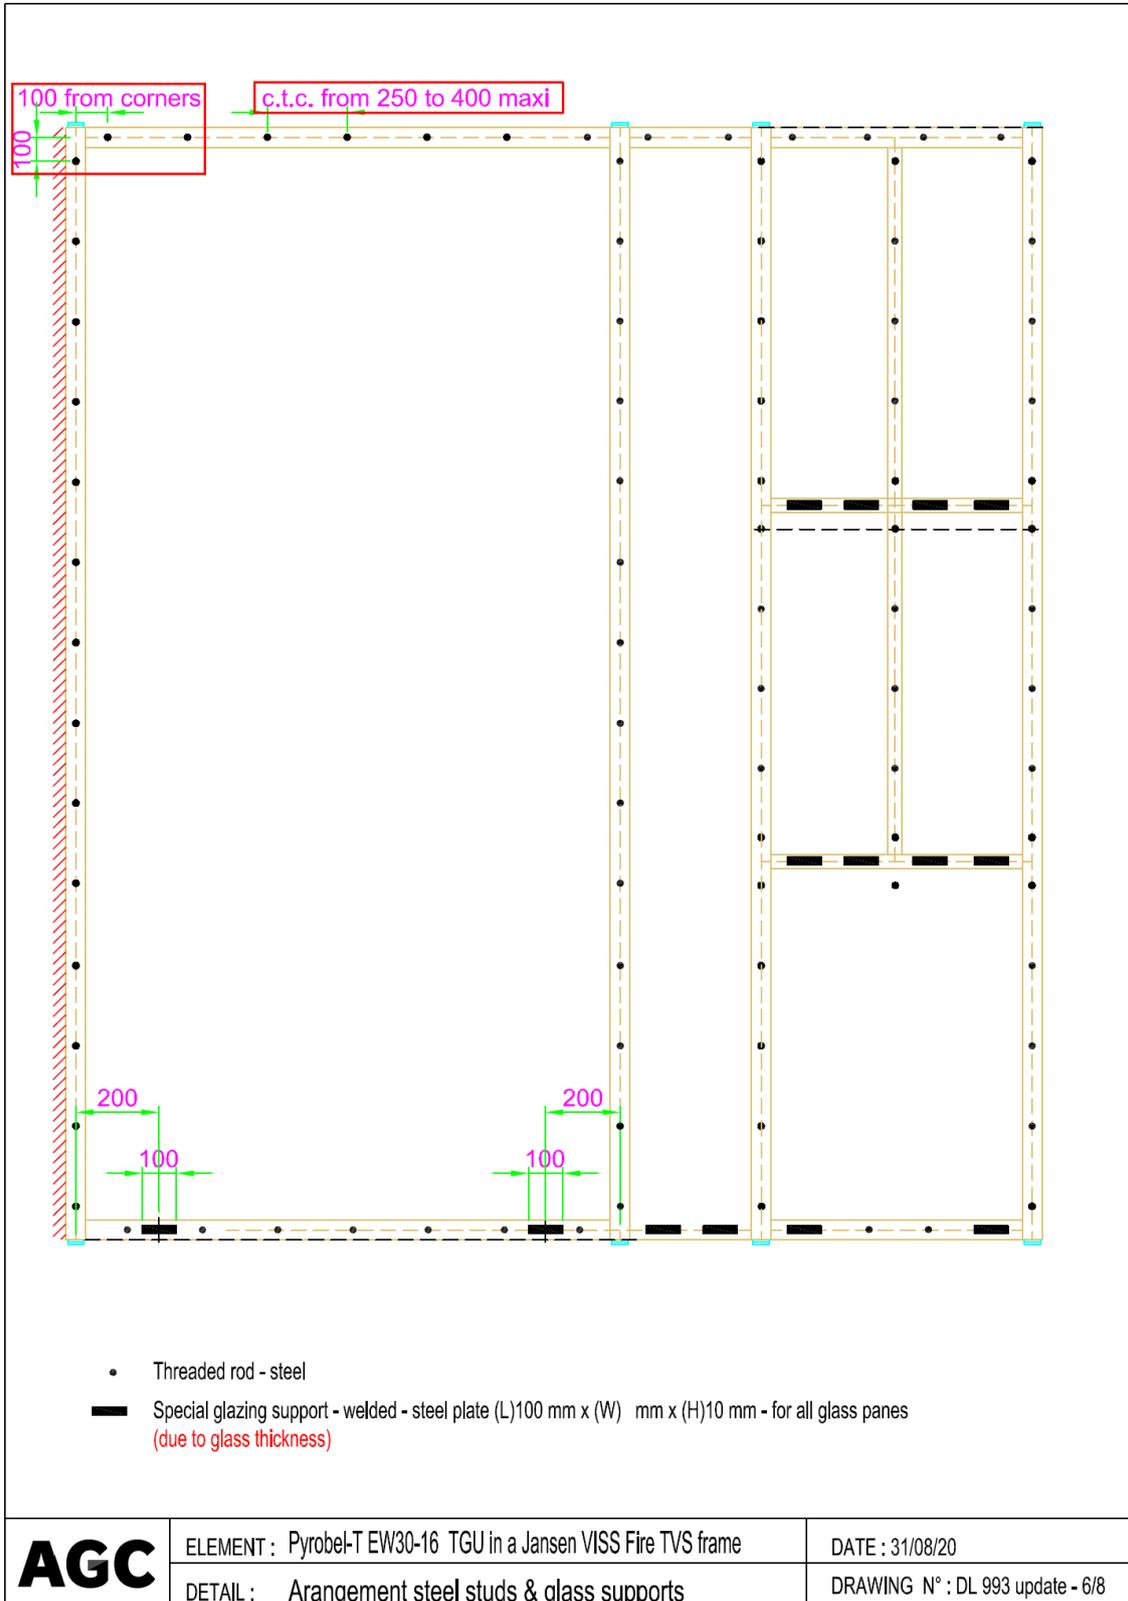

DRAWINGS APPENDIX: Plate No. 7

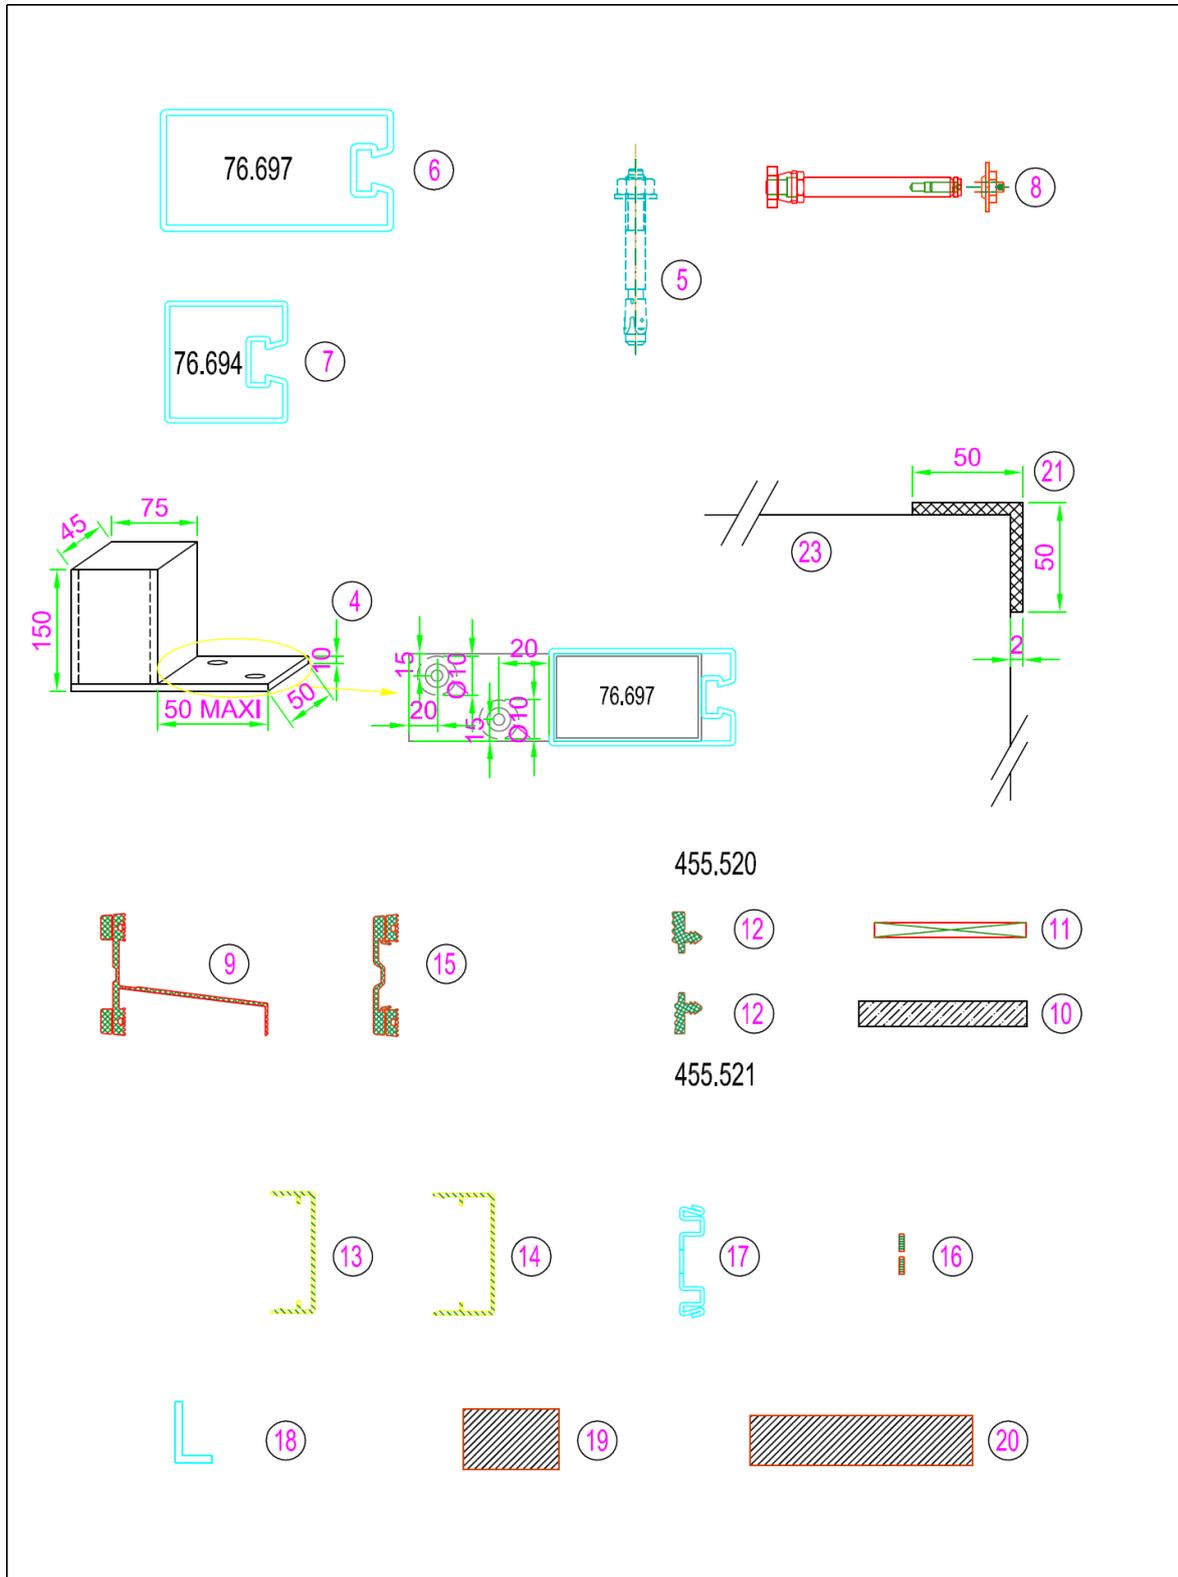


AGC	ELEMENT : Pyrobel-T EW30-16 TGU in a Jansen VISS Fire TVS frame	DATE : 31/08/20
	DETAIL : Materials overview	DRAWING N° : DL 993 update - 7/8

LIST OF THE COMPONENTS APPENDIX: Plate No. 8

# REF.	COMPONENTS	
1	Concrete frame - inner dimensions : 4500 (width) x 4135 (height) mm	
2	Thermal insulation - Promat Promaglaf HTK1100 : 96 kg/m ³	
3	Thermal insulation - mineral wool : 120 kg/m ³	
4	Mounting console	
5	Anchor bolt - Hilti 100 HT : Ø10 x L 72 mm	
6	Profile - steel - Jansen VISS Fire TVS : ref. 76.697 => outer dimensions of section : 95 x 50 mm => inner dimensions of groove : 17 x 6 mm	
7	Profile - steel - Jansen VISS Fire TVS : ref. 76.694 => outer dimensions of section : 50 x 50 mm => inner dimensions of groove : 17 x 6 mm	
8	Fire-proof anchor - Jansen : ref. 452.427 => stainless steel, with pre-assembled key and tenon block, set screw M4, centring nut M4	
9	Inner gasket horizontal - EPDM - Jansen : ref. 455.558	
10	Special glazing support - welded - steel plate (L)100 mm x (W) see drawing x (H)10 mm - (for all glass panes <=> thickness)	
11	Glazing setting block - Jansen : ref.453.070	
12	Outer gasket - EPDM - Jansen : ref. 455.520 / 455.521	
13	Aluminium cover sections - Jansen : ref.407.861	
14	Aluminium cover sections - Jansen : ref.407.862	
15	Inner gasket vertical - EPDM - Jansen : ref. 455.537	
16	Fire protection laminate, self adhesive - Jansen : ref. 451.080 - dimensions 14.4 x 1.8 mm	
17	Steel section - Jansen : ref. 400.867	
18	Steel or aluminium angle profile. 25x25x2	
19	Calcium silicate - Promatect H 58x25 mm	
20	Calcium silicate - Promatect H 90x20 mm	
21	Jung Flamiseal G - 60x2x100 (at each glass pane corner)	
22	Pyrobel-T EW30-16 TGU (T6/4/T6 - air 15 - T6 - air 15 - 44.2)	
AGC	ELEMENT : Pyrobel-T EW30-16 TGU in a Jansen VISS Fire TVS frame	DATE : 31/08/20
	DETAIL : COMPONENTS LIST	DRAWING N° : DL 993 update - 8/8

DRAWINGS APPENDIX: Plate No. 9

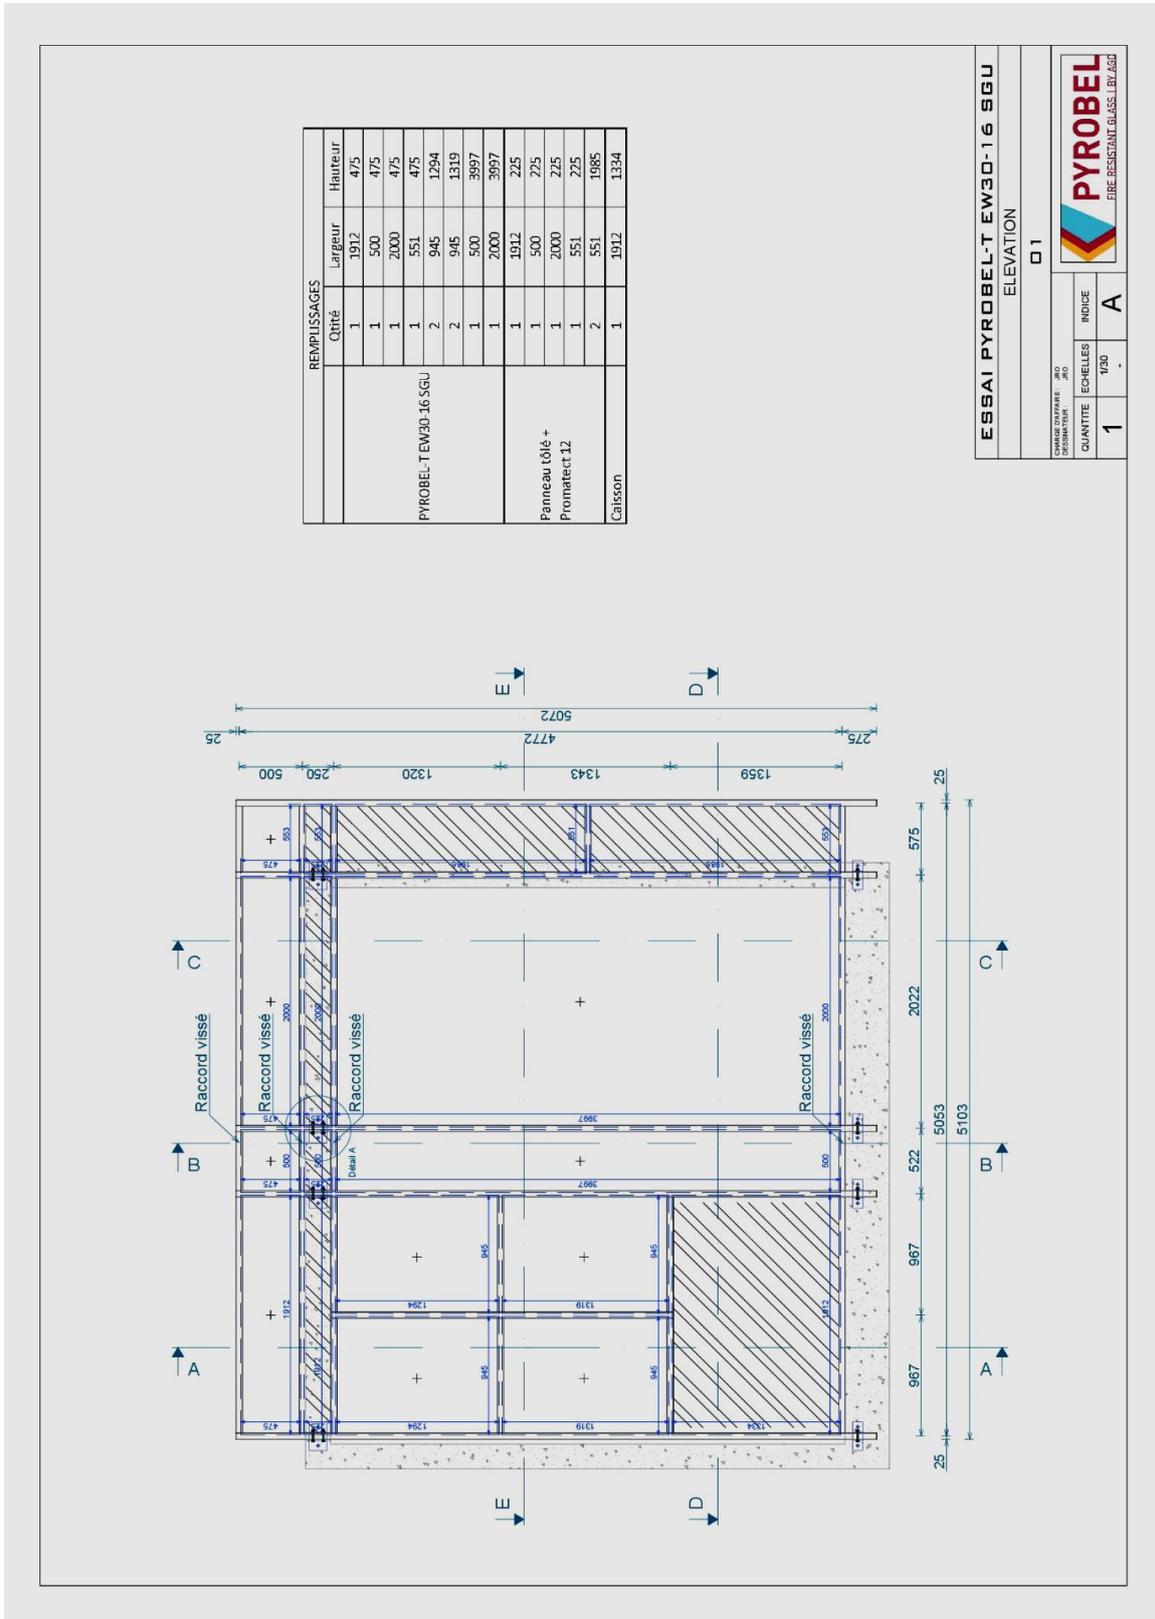

ESSAI PYROBEL-T EW30-16 SGU
ELEVATION
01

CHARGE ZWIFAKE JRD
DESIGNATEUR

QUANTITE 1
ECHELLES 1/30
INDICE A